

Cost of energy system security the Romanian case

Ionut PURICA

Prof.Dr.ing.Dr.ec.c.m.AOSR

EU Green Deal

Comunism ended because it did not internalized the cost of capital; Capitalism may end because it does not internalize the cost of environment

The Green Deal aims at diminishing the costs to the environment by making the EU economy emission neutral at the horizon of 2050.

Action lines:

Energy


Transport

Buildings


Innovation

Energy

Case ROMANIA

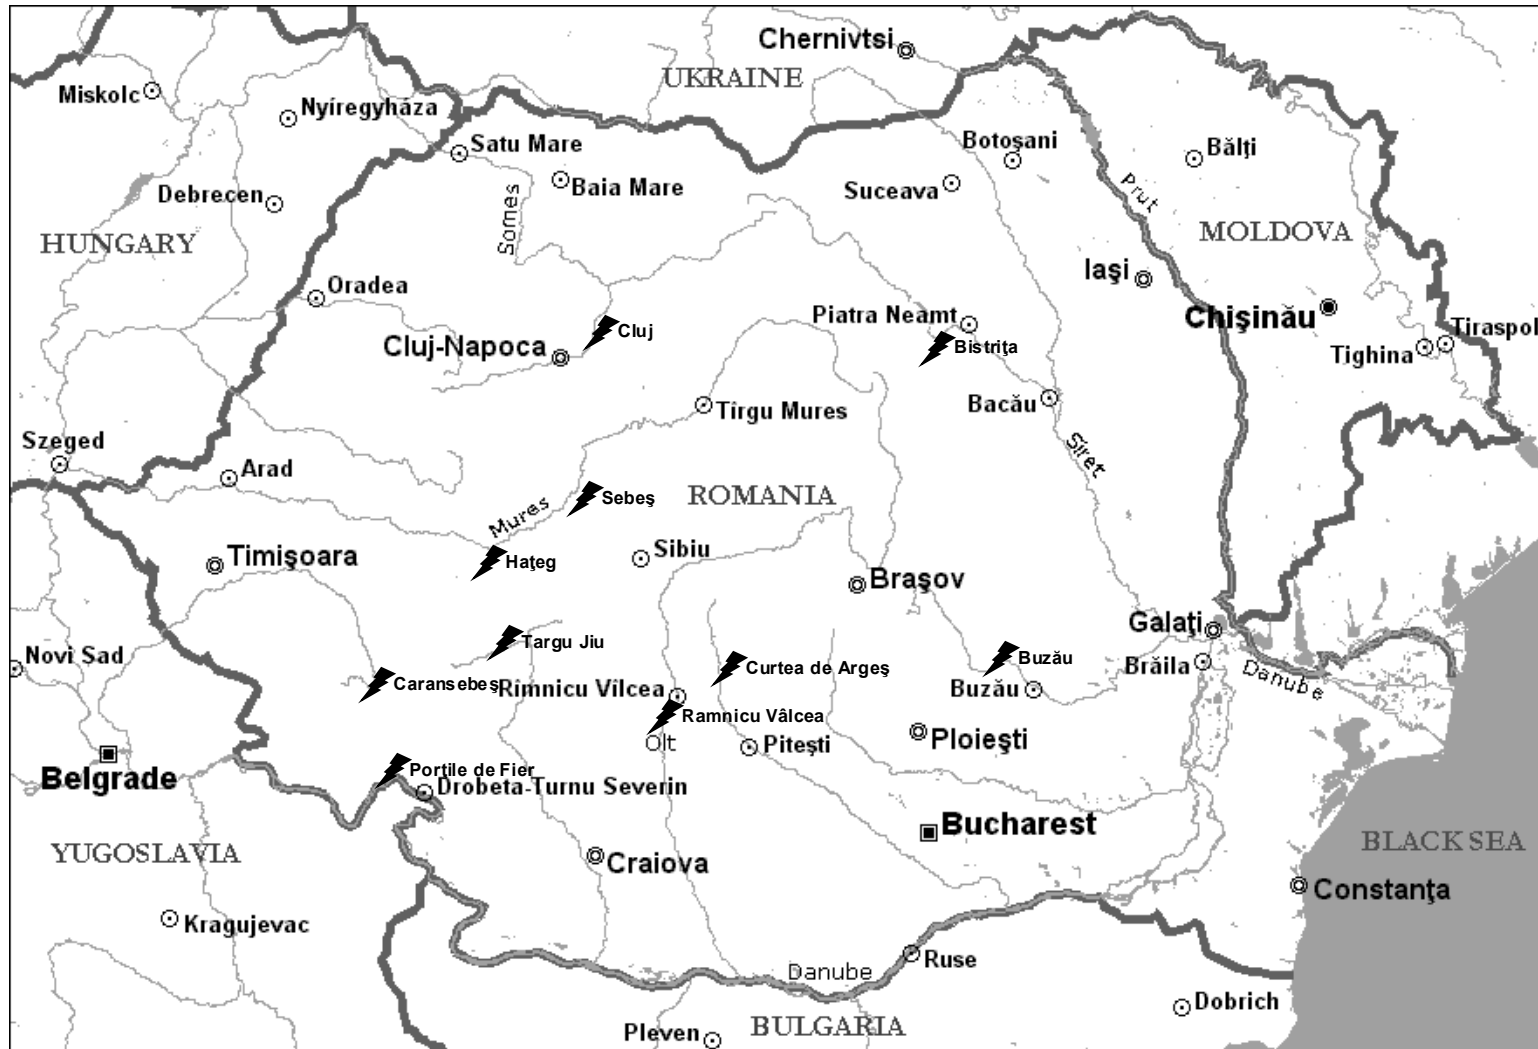

Map 1: Hidroelectrica hydro power plants

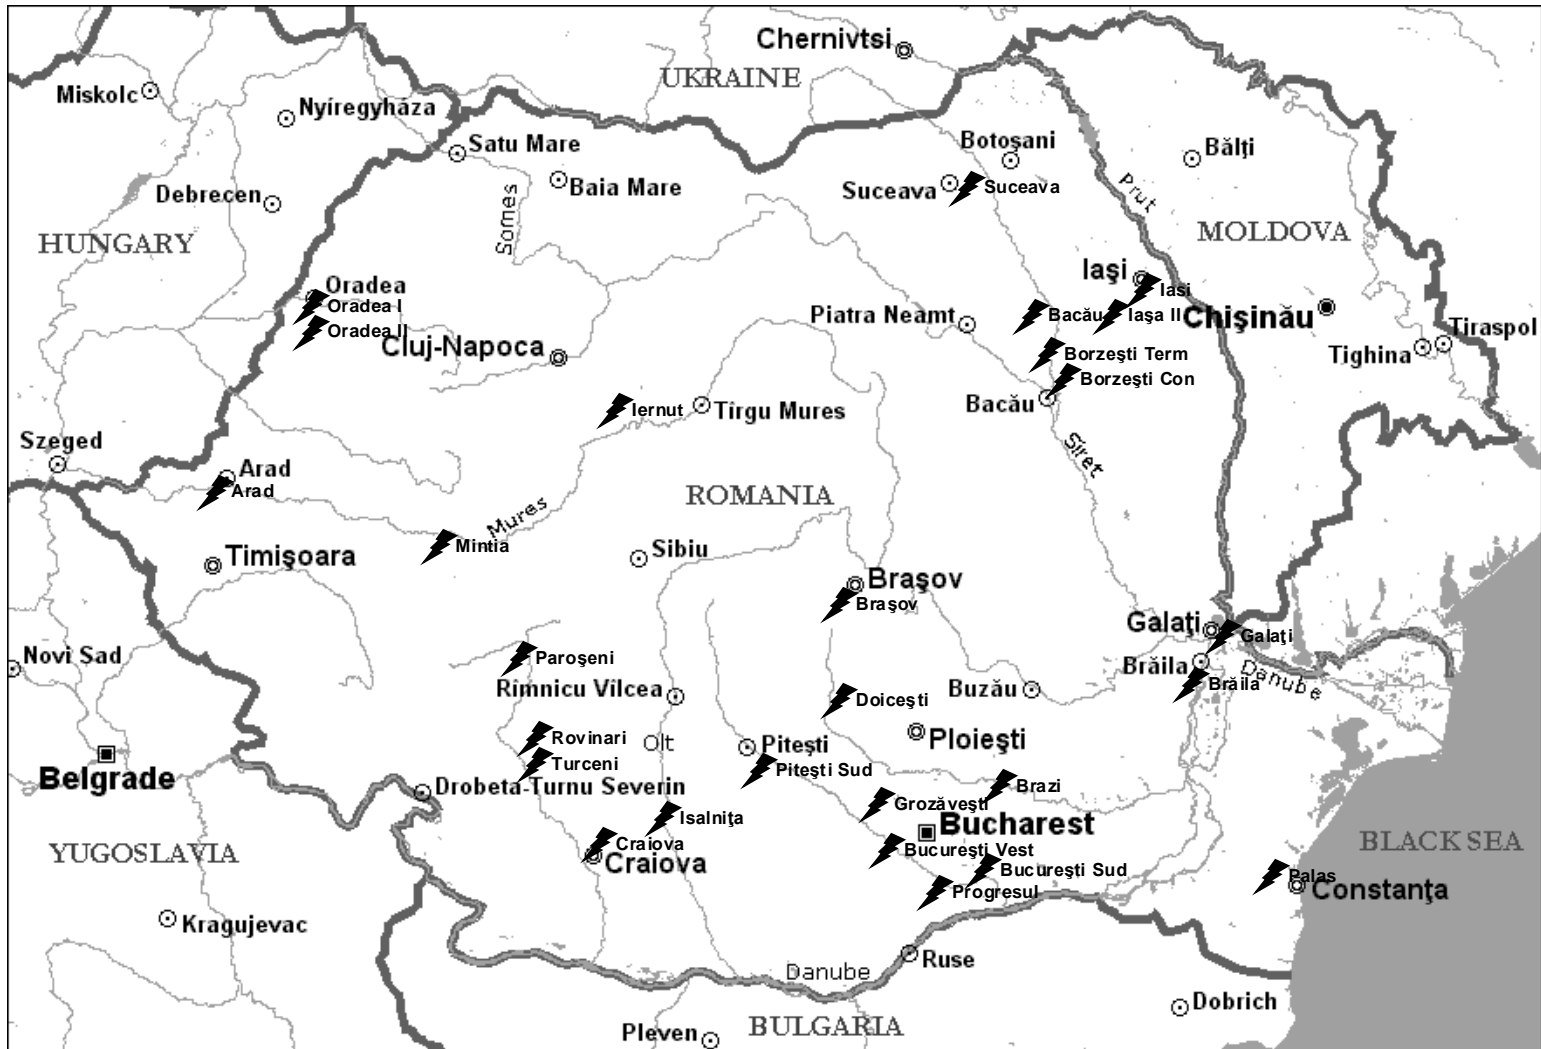

Map 2: Thermoelectrica thermal power plants



**ROMANIA
HARTA RET SI A
CENTRELELOR
ELECTRICE
FOTOVOLTAICE
LA 15.06.2012**

**Legenda
fotovoltaice**


- CENTRALE ELECTRICE FOTOVOLTAICE IN FUNCTIUNE
- CENTRALE ELECTRICE FOTOVOLTAICE CU CONTRACT DE RACORDARE
- CENTRALE ELECTRICE FOTOVOLTAICE CU AVIZ TEHNIC DE RACORDARE
- CENTRALE ELECTRICE FOTOVOLTAICE RACORDATE LA REȚEAȘA ELECTRICA DE DISTRIBUȚIE


SITUAȚIA PROIECTELOR CENTRELELOR ELECTRICE FOTOVOLTAICE

	TOTAL(MW)	RET(MW)	RED(MW)
CU AVIZ TEHNIC DE RACORDARE	683,163	0	683,163
CU CONTRACTE DE RACORDARE	398,94	0	398,94
TOTAL GENERAL	1082,103	0	1082,103
CR.PLA.	2,000	0	2,000

Legenda


- Statie transformare 400/20kV
- Statie transformare 220/110kV
- Statie transformare 400/110kV
- Statie transformare 400/220/110kV
- Statie transformare 400/220kV
- Statie transformare 750/400kV
- Statie conexiune 400kV
- Statie ce nu este in administrarea Transelectrica
- LEA 220 kV
- LEA 400 kV
- LEA 750 kV
- LEA 400 kV propusa
- LEA 110 kV
- Statie de interconexiune cu statele vecine de 110kV
- Statie transformare 400/110kV propusa
- Statie transformare 220/110kV propusa

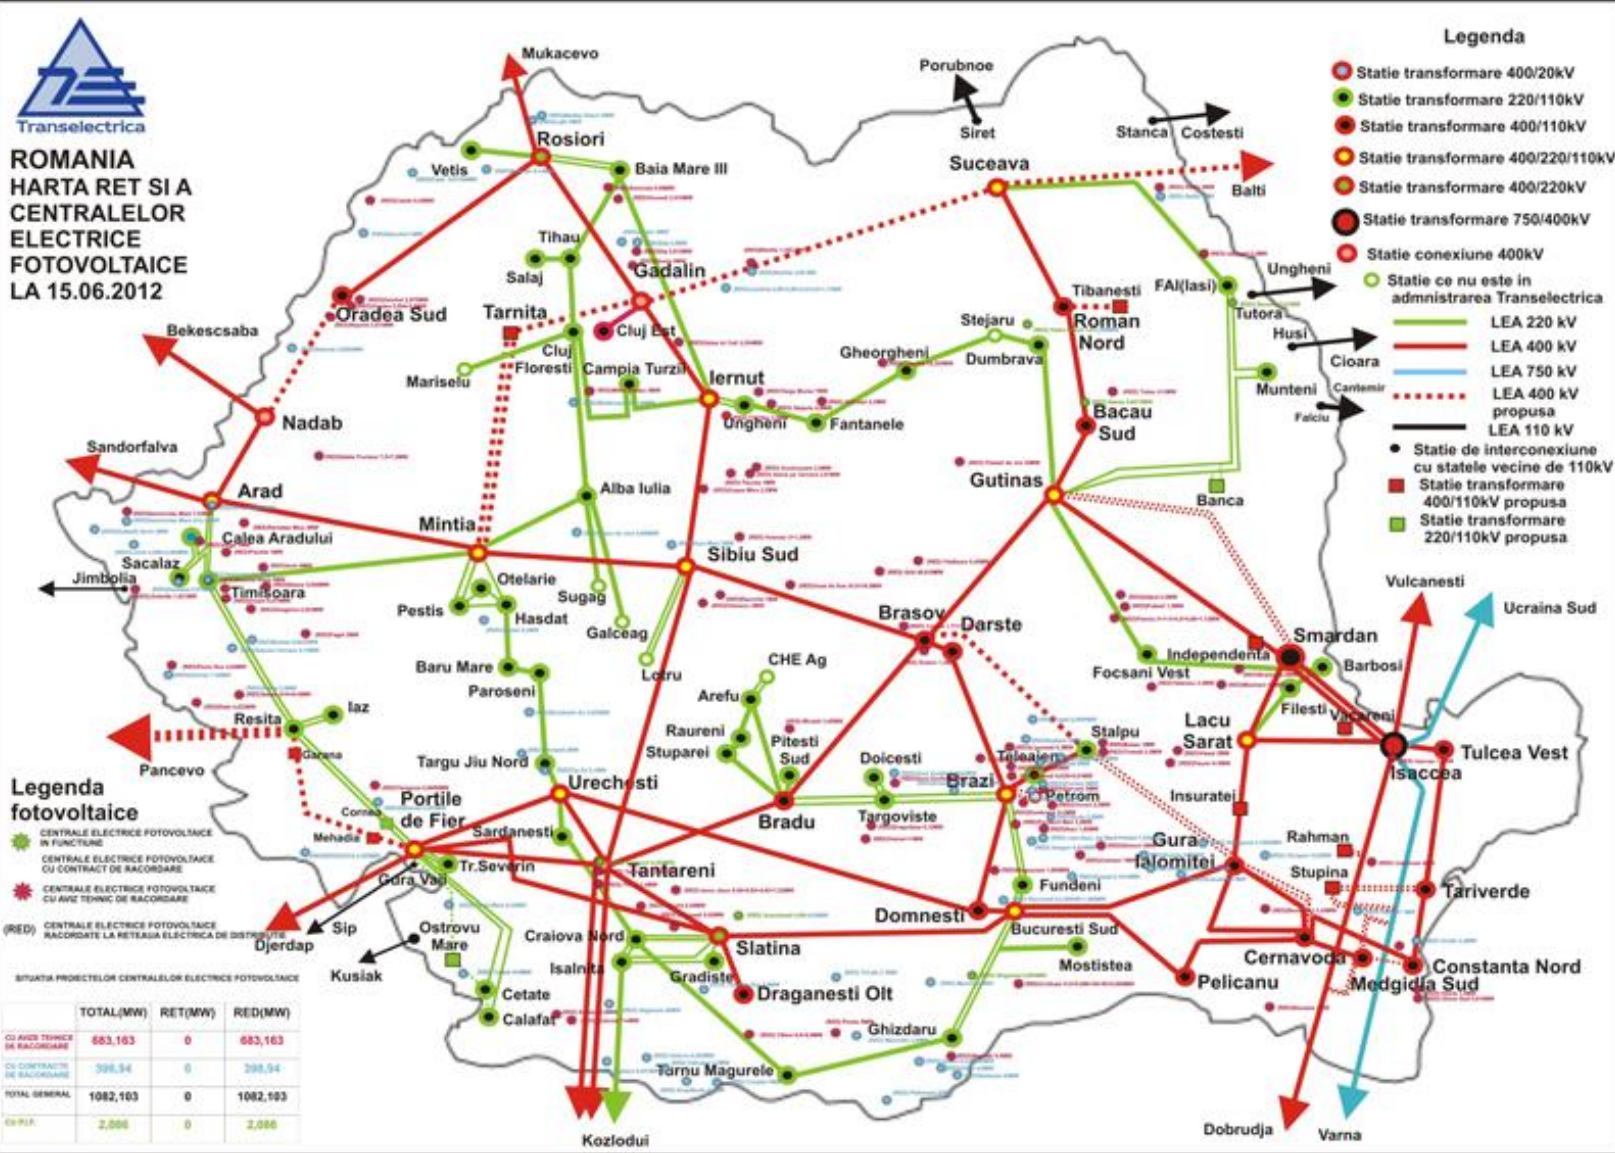

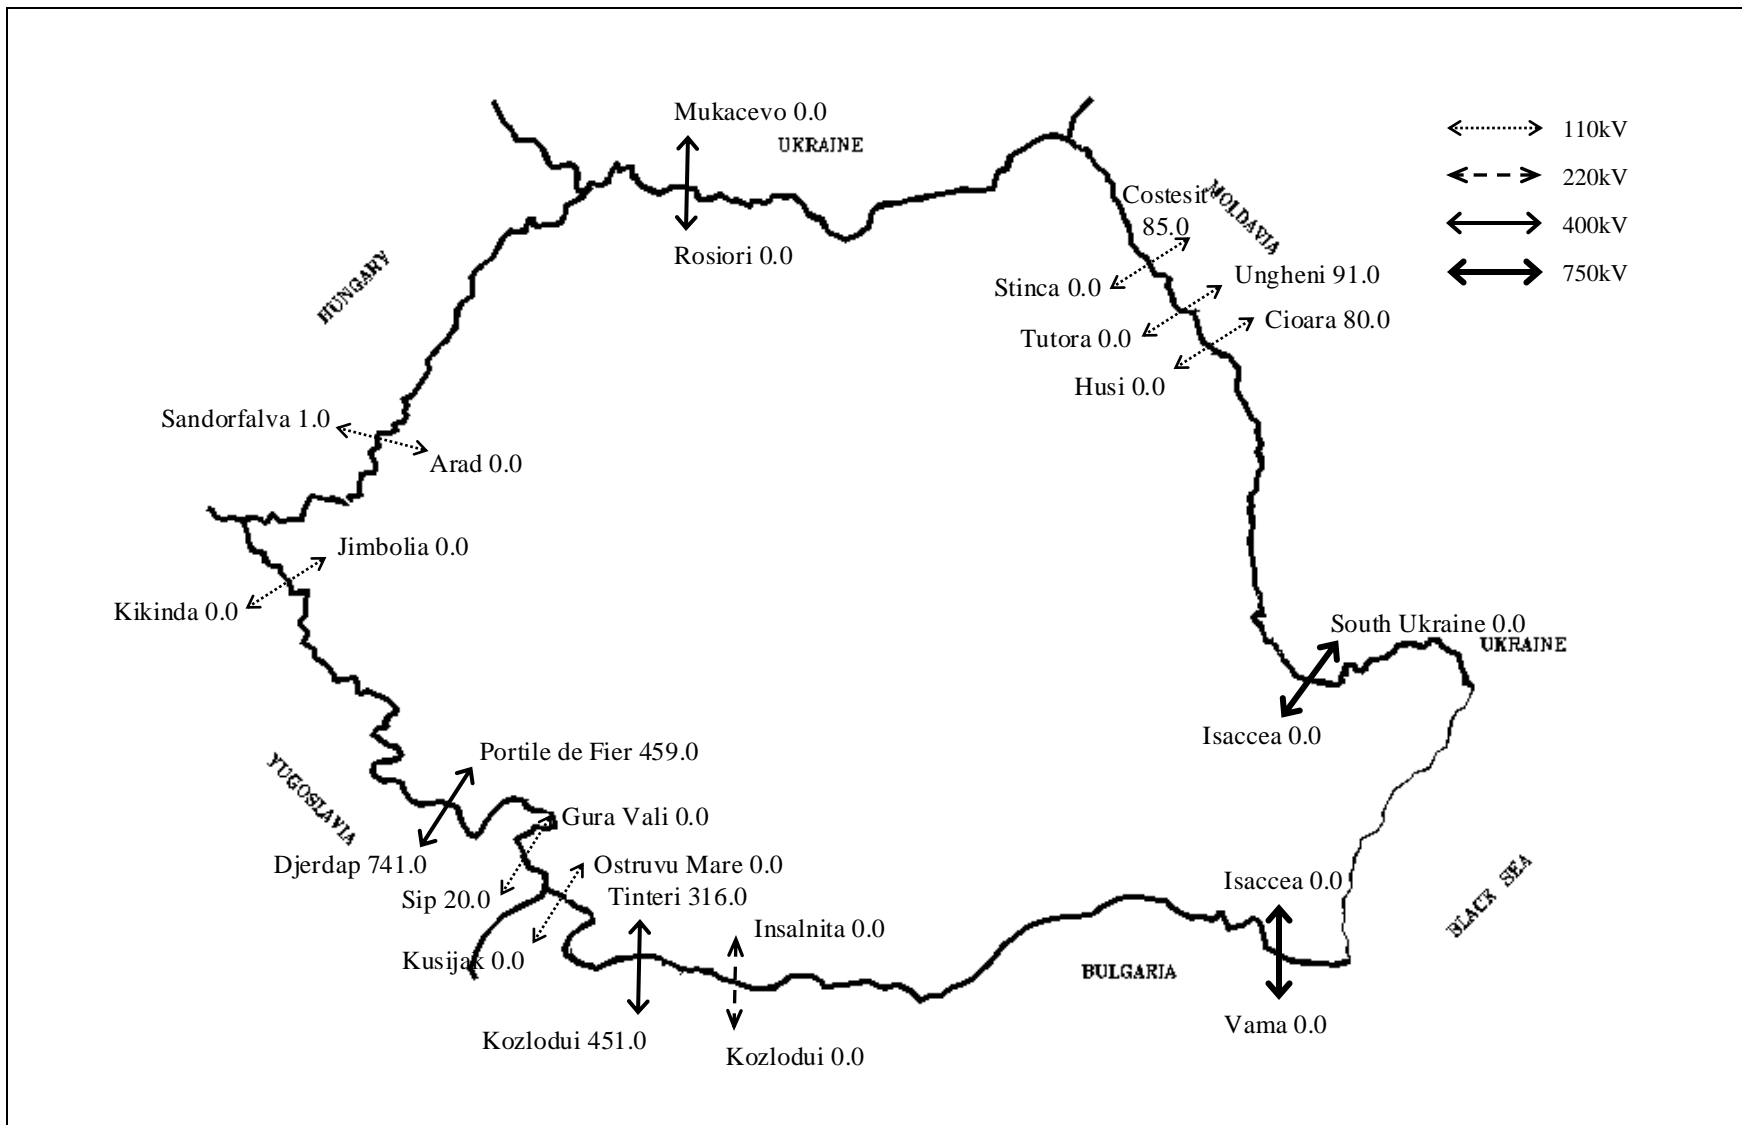

Map 5: Electricity exchanges across interconnections, 2000 (GWh)

Romania power system production

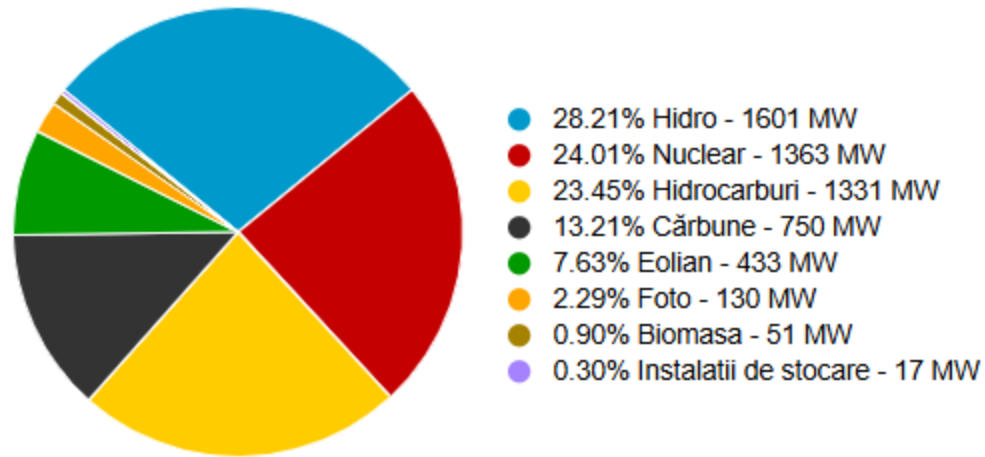


Total 5679 MW - Productia in 23-09-2024 ora 08:07:33

Elements of security

According to the Security strategy of the energy systems launched by the EU Commission in 2014 it is necessary to have a diversified portfolio of electrical energy generation technologies that ensures the coverage of situations when various types of risks manifest themselves. The same applies for gas interconnectors and for the climate change risks impact on critical infrastructures.

The standard deviation of each volatile source is giving the size of the needed reserve of power for the system. The probability distribution are based on real data over sizeable time intervals. For instance for the Danube flow the data period is 1845-2006. For the climate change risks the data period is 1961-2011. For Italy the gas grid risk map is based on earthquake and land slide and mechanical risk, while for Romania it is based on the climate change risks and mechanical risk.

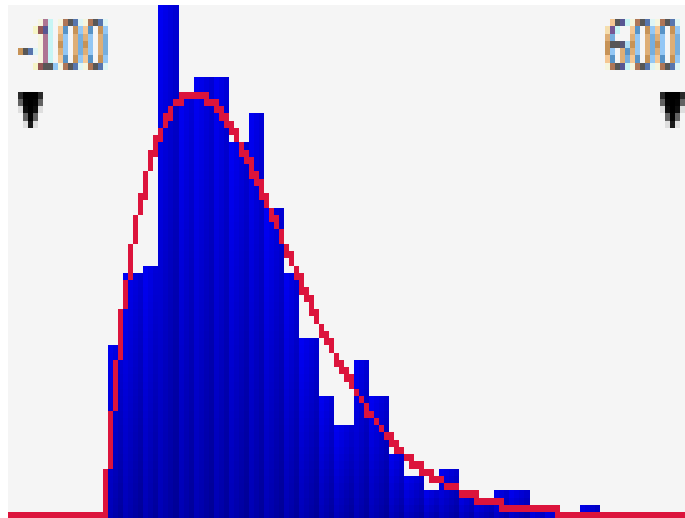


Precipitations




SD/Mean rain	0.6552731 1	hidro lake	
		TWh	16
		TWh lake	4.8
		h/year	8760
		exposure TWh	3.1453109 28
		power MW	359.05375 89

Danube

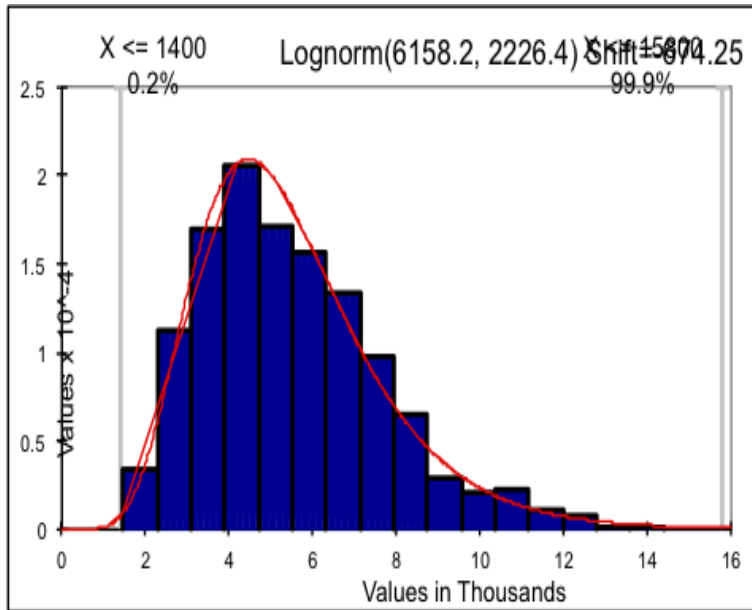


SD/Mean Danube	0.36153			
	4215			
		Needed security hydro run river		
		TWh	16	
		TWh run river	11.2	
		h/year	8760	
		exposure TWh	4.04918	3203
		power MW	462.235	5254

Wind

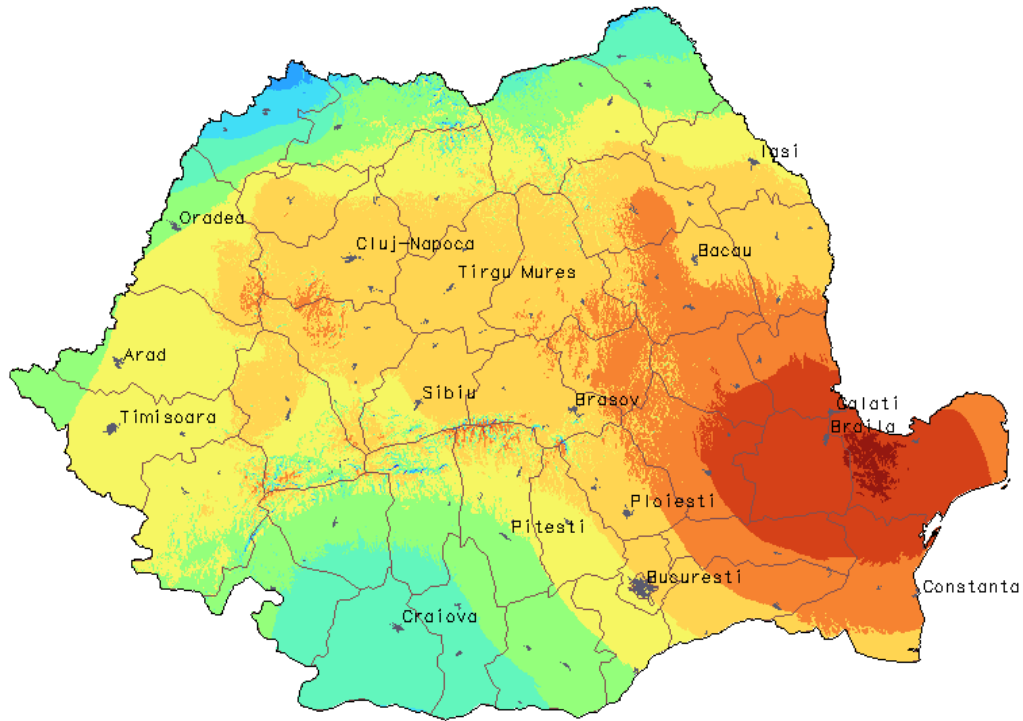

SD/Mean wind	0.5	wind	
		TWh	3
		TWh wind	3
		h/year	8760
		exposure TWh	1.5
		power MW	171.23287 67

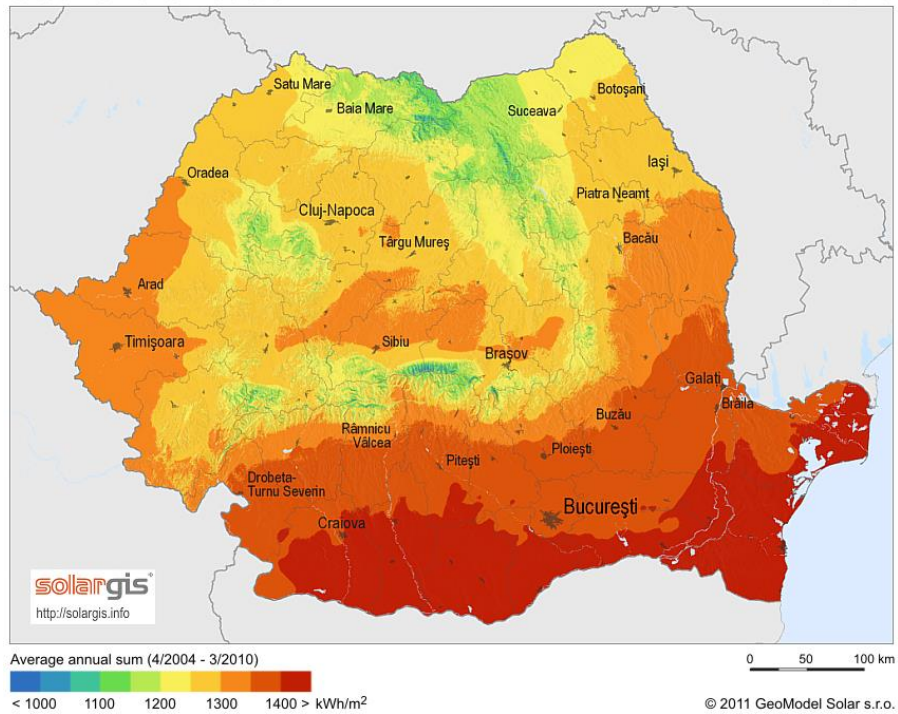

Photovoltaic

SD/Mean PV	0.6	PV	
		TWh	1
		TWh PV	1
		h/year	8760
		exposure TWh	0.6
		power MW	68.493150
			68

In the table below a simulation of a typical financing scheme is presented for a coal power plant of 669 MW having a total of 3000 US\$/kW and a lifetime of 50 years (the monetary units in the table are given in US\$ but they can be replaced with Euro without changing the values).

	A	B	C	D	E	F	G	H	I	J	
1	financing	FI equity	loc. equity	Comm.loan	Exp.loan	LT loan	Bonds	TO: \$/kW	\$mm i10	\$mm i15	\$/Kl
2								FI equity	0.00	0.00	
3	i	0.00	0.00	0.13	0.00	0.07	0.06	loc. equity	0.00	0.00	
4	N	8	8	5	15	15	10	Comm.loan	450.00	450.00	6
5	PMT	0.00	0.00	269.47	0.00	162.76	72.03	Exp.loan	0.00	0.00	
6	capital \$/kWh	0.0720	0.8 utilization		\$/kW PMT SUM		504.26	LT loan	850.00	850.00	12
7	fixed op \$/kWh	0.0131	40.97 \$/KW		\$/kW project life		259.13	Bonds	300.00	300.00	4
8	var oper \$/kWh	0.0011			difference:		94.60%	Total	1600.00	1600.00	23
9	fuel \$/kWh	0.0017	0.47 \$/MWh t		\$/kWh inv. project life:		0.0370	cost adjustment ratio>		1.00	
10	TOTAL \$/kWh	0.0879	3.64 MWh t/MWh					\$mm cap	1600.00		
11	LIFE \$/kWh>>	0.0529	0.0350 B10-B11					-idc	0.00		
12	WDR	life	PV cap	PV fix op	PV var op	PV fuel	PV kWh	-pr.conting	0.00		
13	0.08452	50	3012.72	1068.30	89.63	139.85	81477.64	-wk.cap	0.00		
14	AFUDC = allowance for funds used during construction							other adj	0.00		
15	YTC = years to commissioning							net capital	1600.00		
16	WDR = weighted discount rate							MW	669.6		
17	ERROR verifies i8 and i29							\$/kW	2389.49		
18	Capital charge unit components:										
19		FI equity	loc. equity	Comm.loan	Exp.loan	LT loan	Bonds	TOTAL			
20	\$/kWh>>>	0.0000	0.0000	0.0385	0.0000	0.0232	0.0103	0.0720			
21											
22	AFUDC calc.	FI equity	loc. equity	Comm.loan	Exp.loan	LT loan	Bonds	YTC	cashflow %		
23		0.00	0.00	92.81	0.00	79.51	25.39	5	0.15	All cost data \$/k	
24		0.00	0.00	71.15	0.00	62.92	20.15	4	0.15		
25		0.00	0.00	51.91	0.00	47.34	15.20	3	0.15		
26		0.00	0.00	34.82	0.00	32.73	10.54	2	0.15		
27		0.00	0.00	26.19	0.00	25.35	8.18	1	0.20		
28		0.00	0.00	8.22	0.00	8.18	2.65	0	0.20		
29	afudc/kW	0.00	0.00	285.09	0.00	256.03	82.11	623.23	1.00		1.00
30	\$/kW <afudc	0.00	0.00	672.04	0.00	1269.41	448.03	2389.49			
31	\$/kW w. afudc	0.00	0.00	957.13	0.00	1525.44	530.14	3012.72			
32											
33	For WDR: "i" weighted by PMT shares; N = 1										
34		FI equity	sp. equity	Comm.loan	Exp.loan	LT loan	Bonds	TOTAL			
35	PMT	0.00	0.00	1077.73	0.00	1625.36	561.95	3265.04			



The 3 seas initiative and
gas network security

North South
interconnector

Dependency on Russian gas imports

Safety enhancing interconnector
“From the Varangians to the Greeks”

Share of Russian gas
in consumption

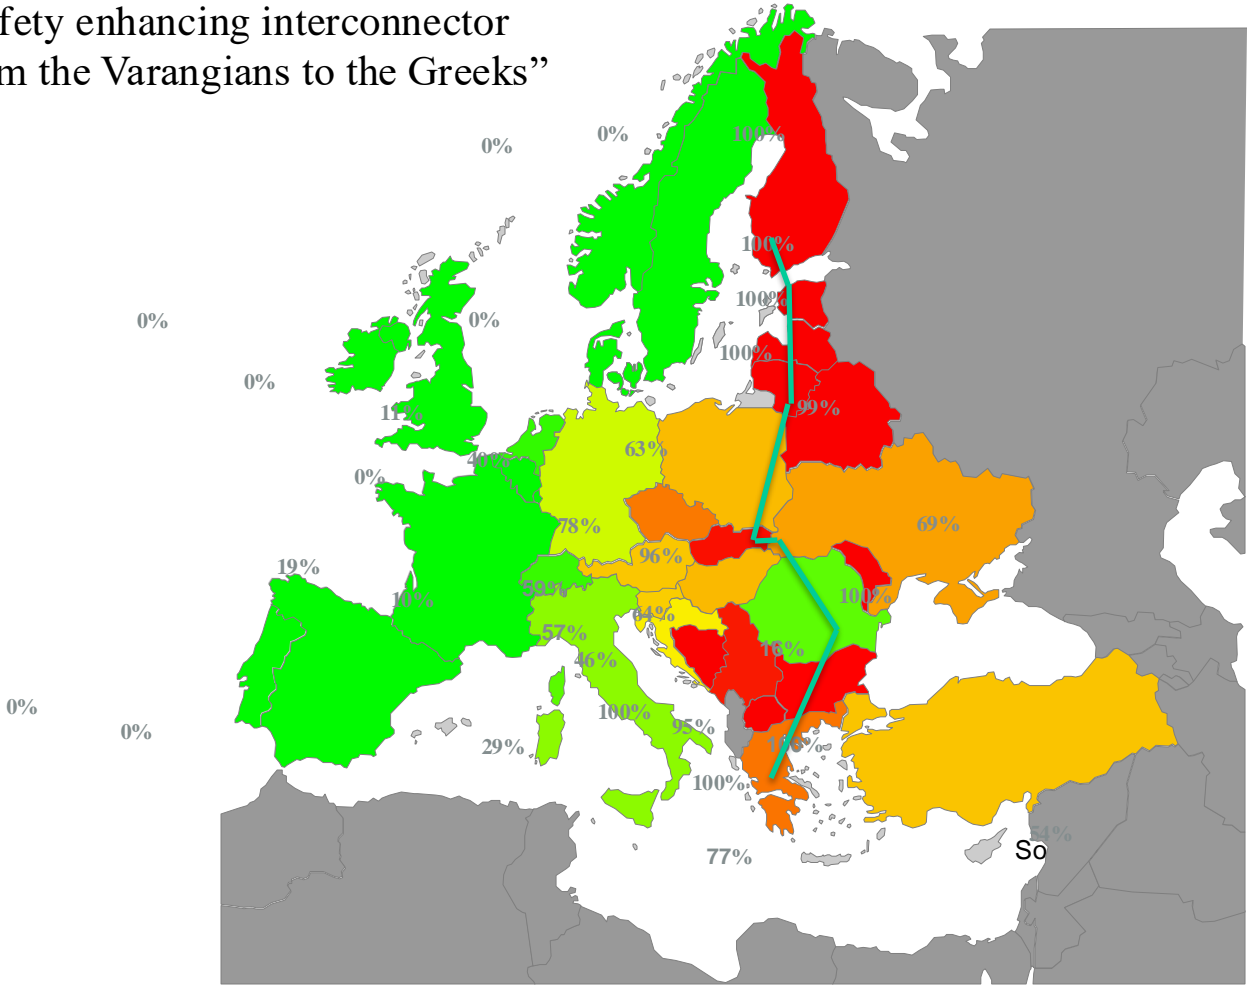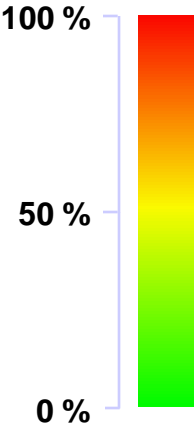

Source : CEDIGAZ- Estimate of international gas trade by pipeline in 2009


Climate change risk

Big data analysis needed





Potential Insurance policy

Event tree for Climate change events


Temperature *Precipitations* *Event type*

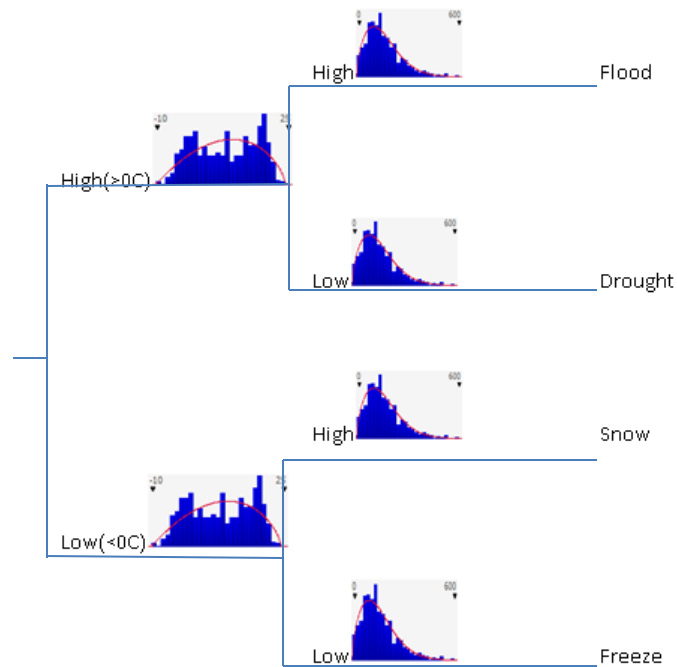

Risk maps




Total CC events risk map [thousands US\$] distribution of risk premium per capita

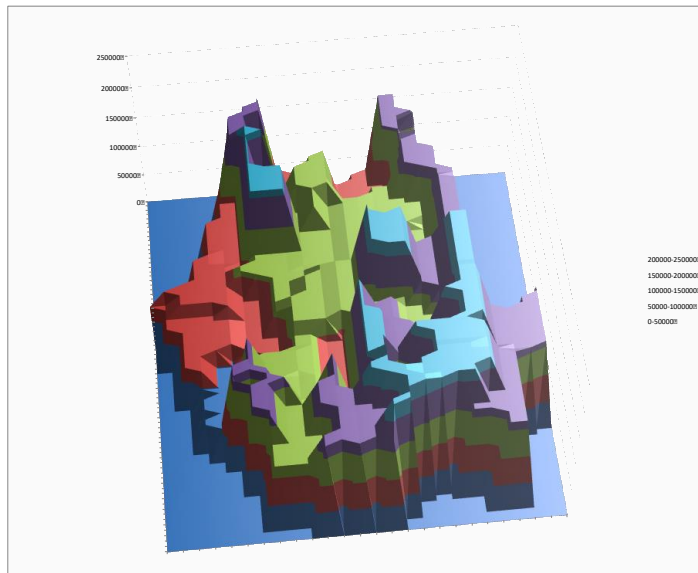


County	Premium Risk /cap US\$	County	Premium Risk /cap US\$
Bucuresti	0	Harghita	19.68
Alba	17.05	Hunedoara	8.44
Arad	11.81	Ialomita	43.59
Arges	8.28	Iasi	12.27
Bacau	8.33	Ifov	6.68
Bihar	8.43	Maramures	8.31
Bistrita Nasaud	27.29	Mehedinti	32.56
Botosani	20.53	Mures	11.32
Braila	35.06	Neamt	11.59
Brasov	12.96	Olt	21.09
Buzau	16.20	Prahova	11.77
Calarasi	40.17	Salaj	51.13
Caras Severin	8.74	Satu Mare	31.13
Cluj	8.77	Sibiu	17.69
Constanta	13.86	Suceava	5.13
Covasna	59.81	Teleorman	23.70
Dambovita	22.91	Timis	6.71
Dolj	9.90	Tulcea	36.61
Galati	20.83	Valcea	15.41
Giurgiu	46.07	Vaslui	22.73
Gorj	16.76	Vrancea	25.50

Romania gas grid CC and mechanical risk [probable deaths/1000 cap]

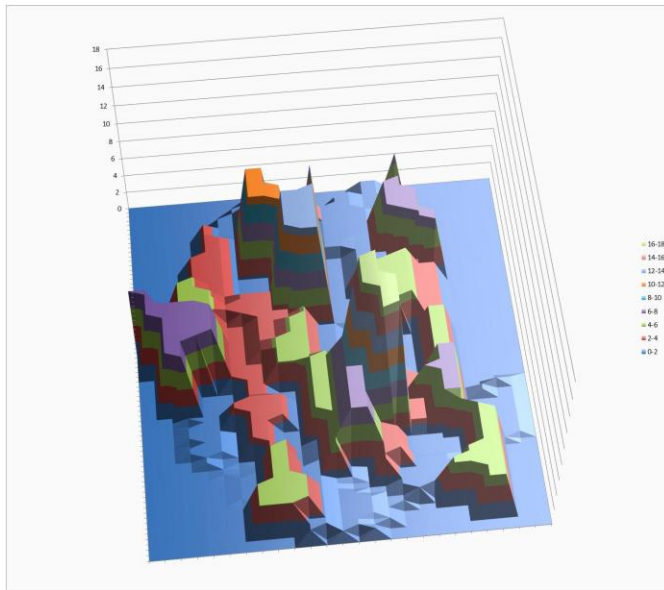

Natural gas risk in Italy [probable deaths / million inhabitants]

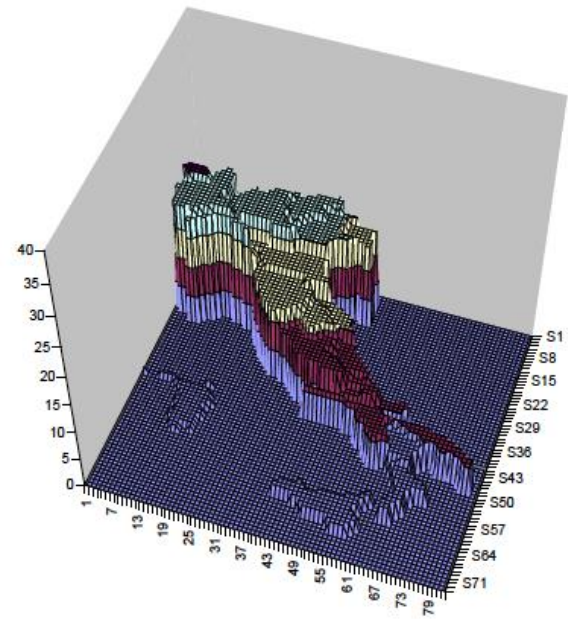

Forecasting and planning


Models for the energy
system penetration of new
technologies

Optimize for emissions
reduction

ACTING FOR THE NEAR FUTURE

MESSAGE results for 3 Scenarios for Nuclear/Renewable ratio in the NEMix until 2035

Goal: Select the optimal Nuclear/Renewable ratio in the NEMix until

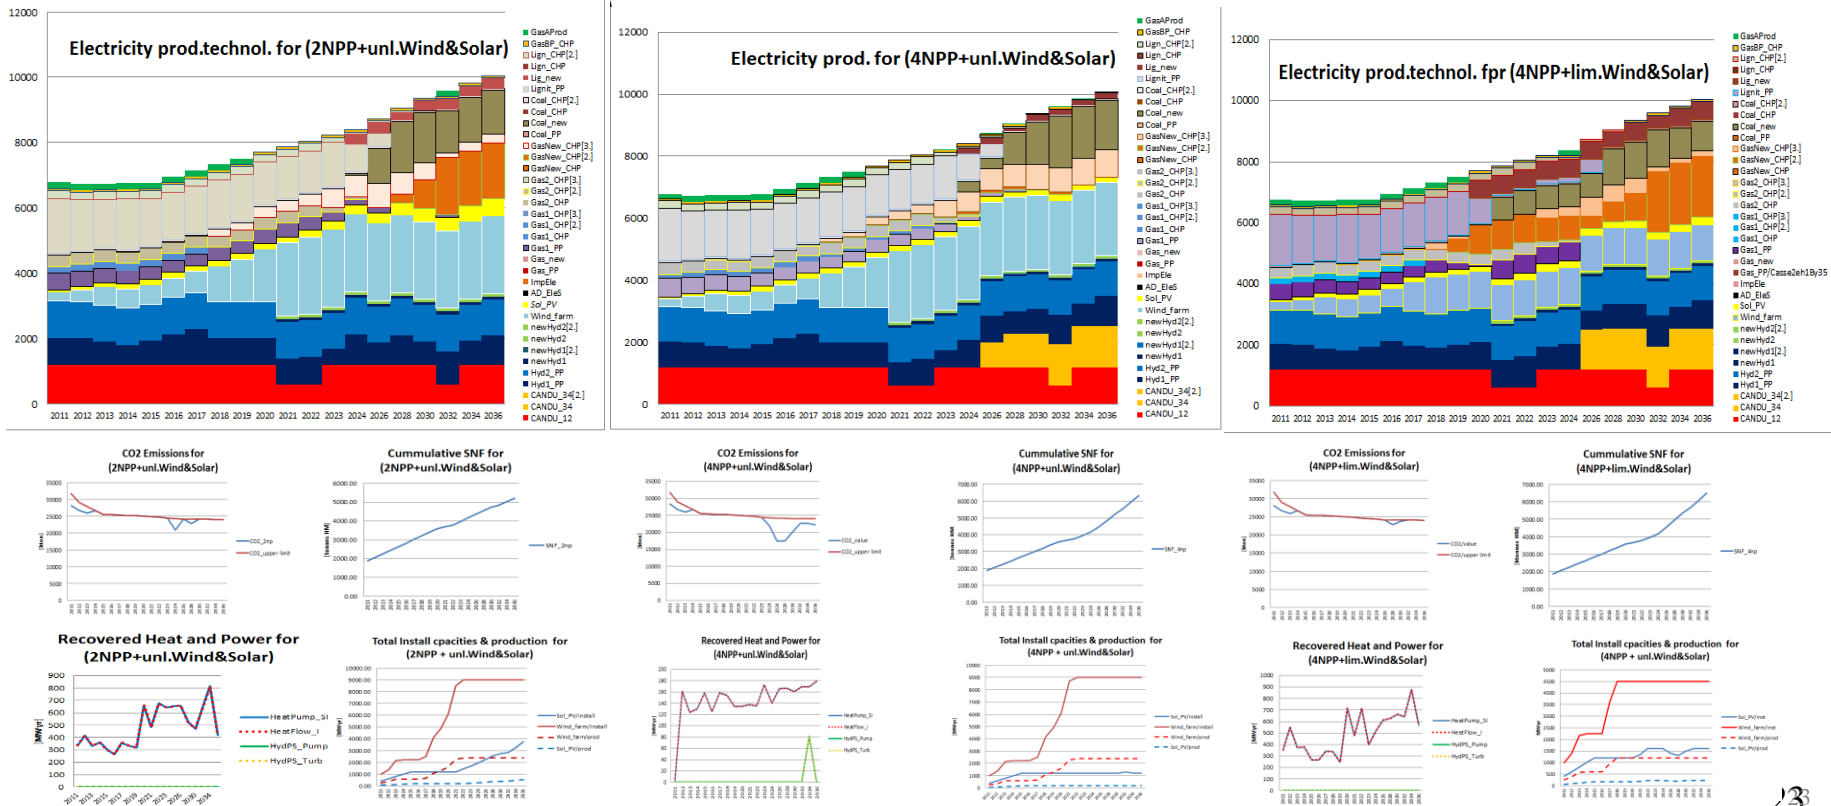

Nuclear fuel cycle

Large power emission free
technology

New small modular reactors

Will fusion be in time ?

Conclusions

the results of evaluating the mitigation and adaptation measures to the risks in the energy system (considering only hydraulicity, wind and photovoltaic) lead to the need of coal capacities of at least 1000 MW

Security to gas supply may be enhanced with North South interconnectors that link the three seas in the East of the EU.

Climate change risk becomes important and an insurance policy should be considered fast.

The energy sector may not be regarded from only a commercial view point, its strategic importance as well as the social one make necessary taking into consideration noncommercial costs that must be internalized in the financing scheme to reach optimal decisions.

Transport

The largest local emitter

Home work:

Consider the energy consumed as fuel for transport in EU

Change transport to electric till 2050

Generate the same amount of energy to charge the batteries of the electric vehicles

How much new installed power will be needed each year and what will be the cost of investment ?

Potential subject for a study on green deal in transport.

Electrical busses used in the centre of Rome



Buildings

40% of the energy consumption goes to buildings in the EU

Raising buildings efficiency involves various technologies e.g. thermal insulation, windows energy conversion materials, internal lighting, etc.

This leads to zero energy (passive) buildings as a component of smart cities concept, that could also store energy in cement batteries

40% of the energy consumption goes to buildings in the EU

Raising buildings efficiency involves various technologies e.g. thermal insulation, windows energy conversion materials, internal lighting, etc.

This leads to zero energy (passive) buildings as a component of smart cities concept, that could also store energy in cement batteries



Thermal and visible image



Distributed generation for off grid buildings

Innovation

New technologies are needed, with short time to market, in order to achieve neutrality. Financing innovation is a must.

Suggestion: raise the budget deficit from 3% to 4% if the extra 1% is spent on innovation and implementation of new technologies toward neutrality.

Generate a coherent system of international cooperation to do research and latter to disseminate the results.

Involve corporate research and bring value added to the generated patents

Circular Economy

Change economic structure and dynamic from linear to circular

Devise innovative financial schemes for clean technological investments

Change waste liabilities into resource assets through new technologies to minimize and eventually eliminate carbon footprint.

THANK YOU

puricai@yahoo.com

+40745167781